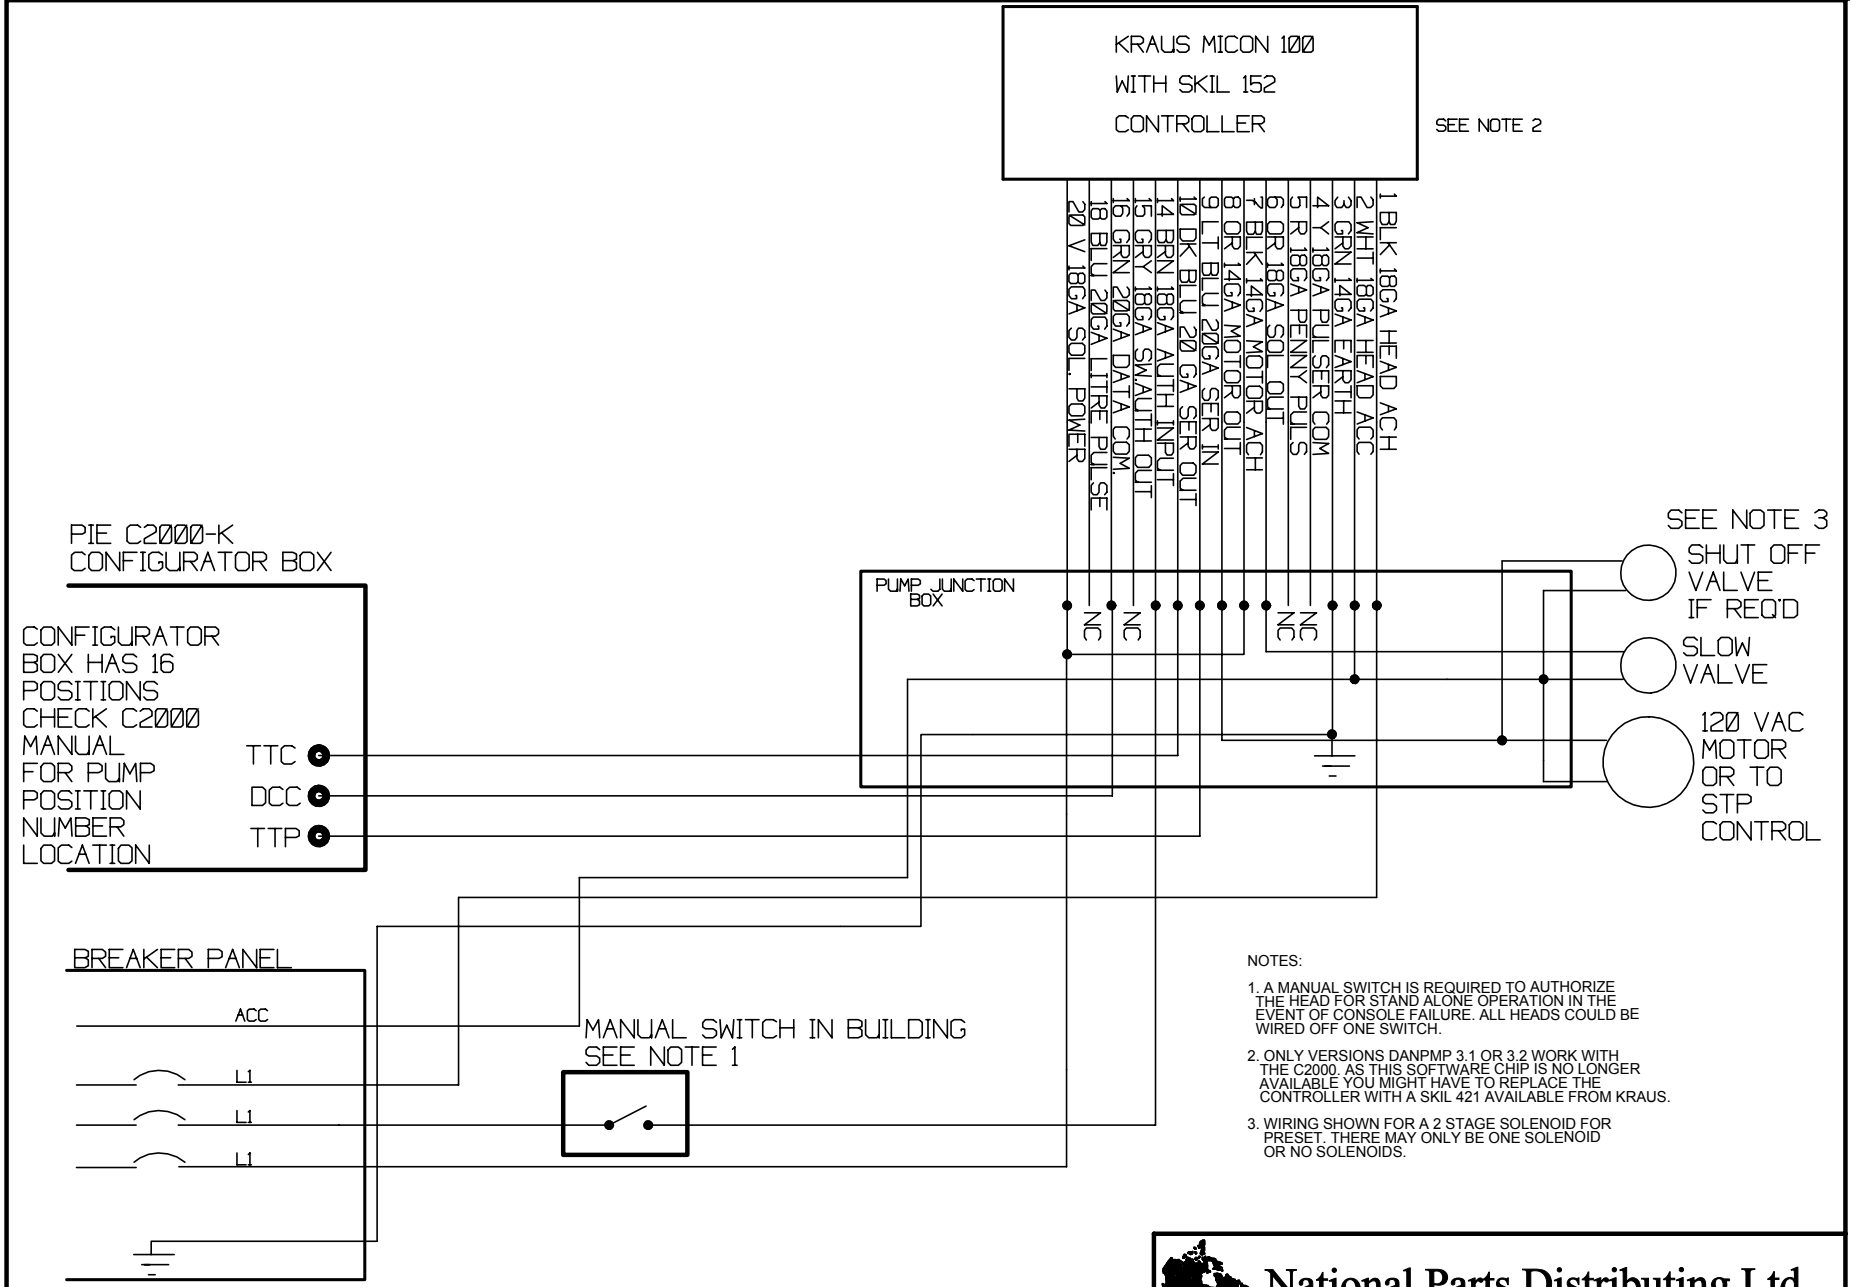

NOTES:

1. A MANUAL SWITCH IS REQUIRED TO AUTHORIZE THE HEAD FOR STAND ALONE OPERATION IN THE EVENT OF CONSOLE FAILURE. ALL HEADS COULD BE WIRED OFF ONE SWITCH.
2. ONLY VERSIONS DANPMP 3.1 OR 3.2 WORK WITH THE C2000. AS THIS SOFTWARE CHIP IS NO LONGER AVAILABLE YOU MIGHT HAVE TO REPLACE THE CONTROLLER WITH A SKIL 421 AVAILABLE FROM KRAUS.
3. WIRING SHOWN FOR A 2 STAGE SOLENOID FOR PRESET. THERE MAY ONLY BE ONE SOLENOID OR NO SOLENOIDS.

National Parts Distributing Ltd.

TITLE:

C2000-K PROGRESSIVE INTERNATIONAL ELECTRONICS SERIAL CONSOLE TO KRAUS MICON 100 ELECTRONIC HEAD WIRING SCHEMATIC

DATE-	SCALE-	DRN BY-	REV.DATE-
FEBRUARY 2002	NTS	HFB	

DR.NO.- A00378

REV.NO.-

C:\My Documents\Drawings\A400\A00378.vcd 7/9/2002